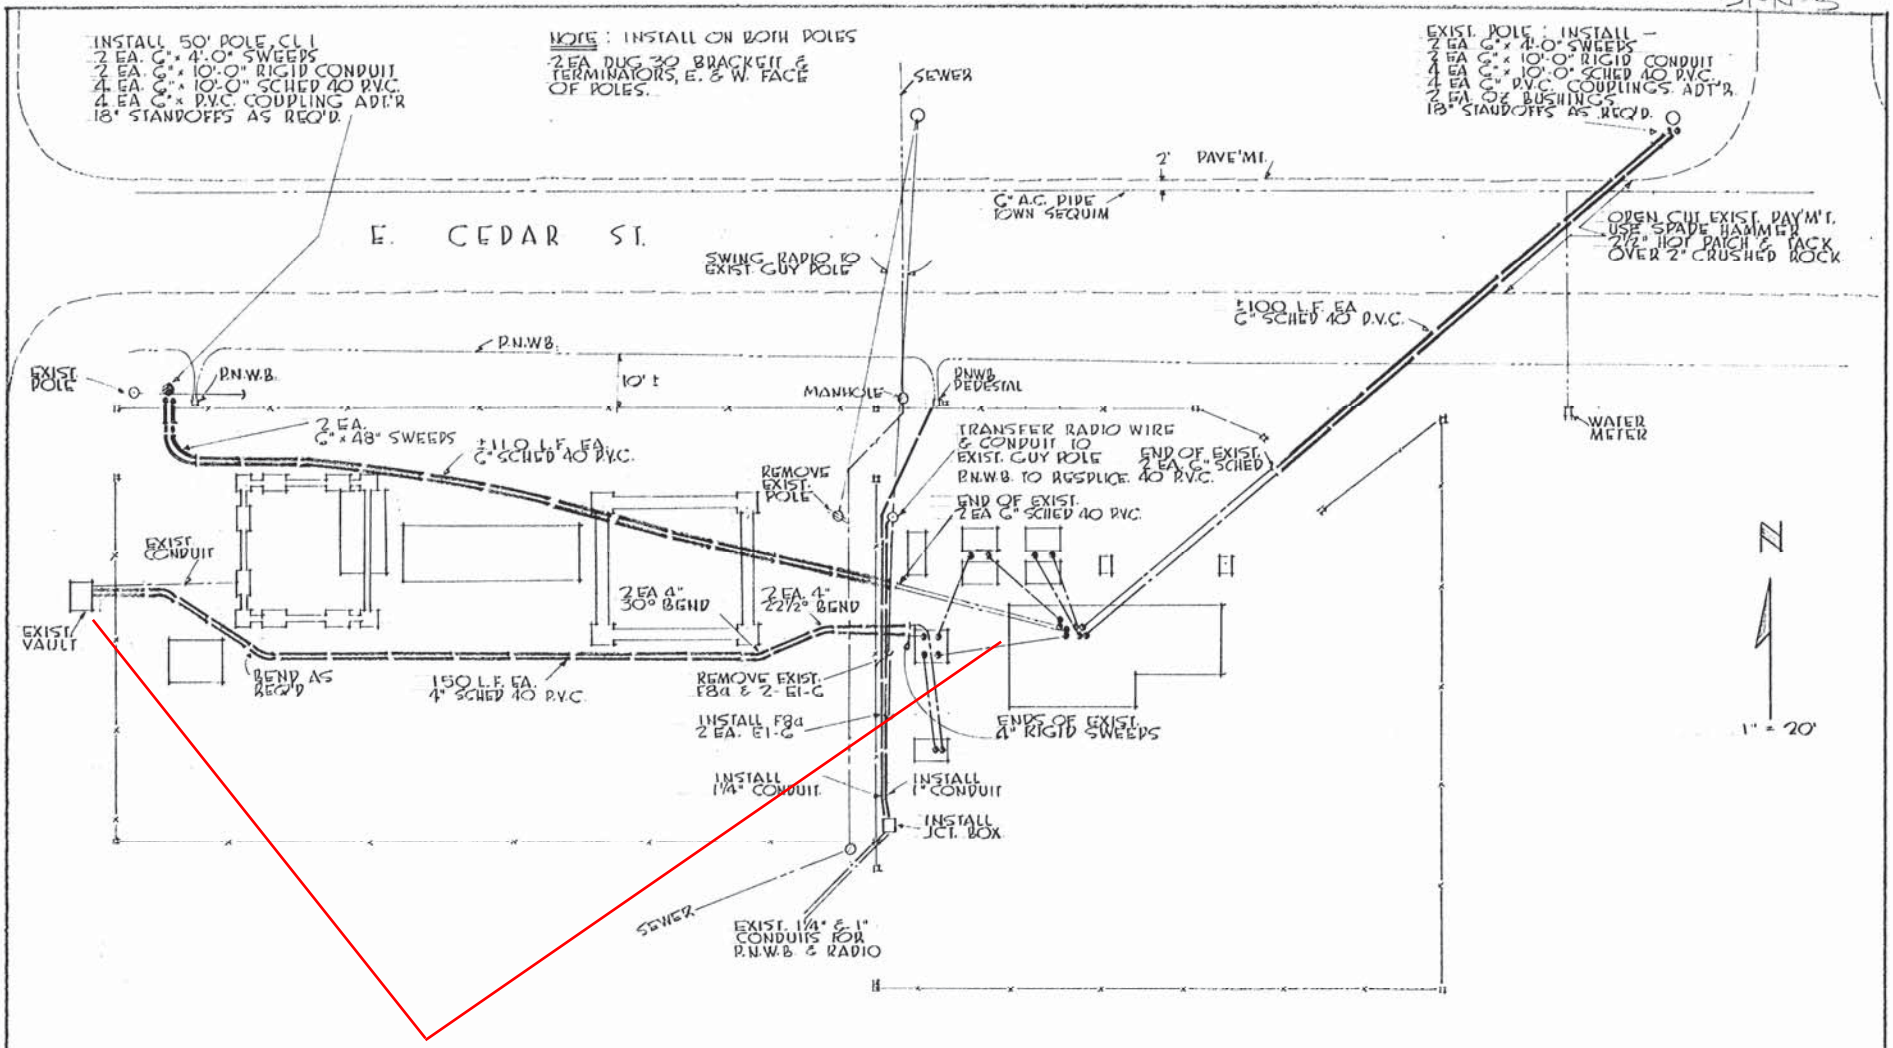

Communication cable in conduit run between vault and Control Building. Exact location unknown.

CONDUIT FEEDER RUNS - SEQUIM SUB

TREAT 4/80

W. O. # AK 226

CABLES:

FOR EA. 6" CONDUIT: 3 EA / 1000 MCM
1 EA / #4/0 NEUTRAL.

FOR 4" IN TRSF FEED THRU POSITION: 3 EA / #1/0 URD.

OTHER 4": 3 EA / 350 MCM w/ CONC. NEUTRAL.